


SEGREGATION OF BIO-MEDICAL WASTE

[ANNEXURE TO CONTRACTUAL AGREEMENT - CLAUSE 2 PAGE 1]

Please note that all bags, handed over the service provider, shall be labeled as per Schedule IV (Rule 6) of the Biomedical Waste (Management & Handling) Rules, 1998.

HOSPITAL WASTES

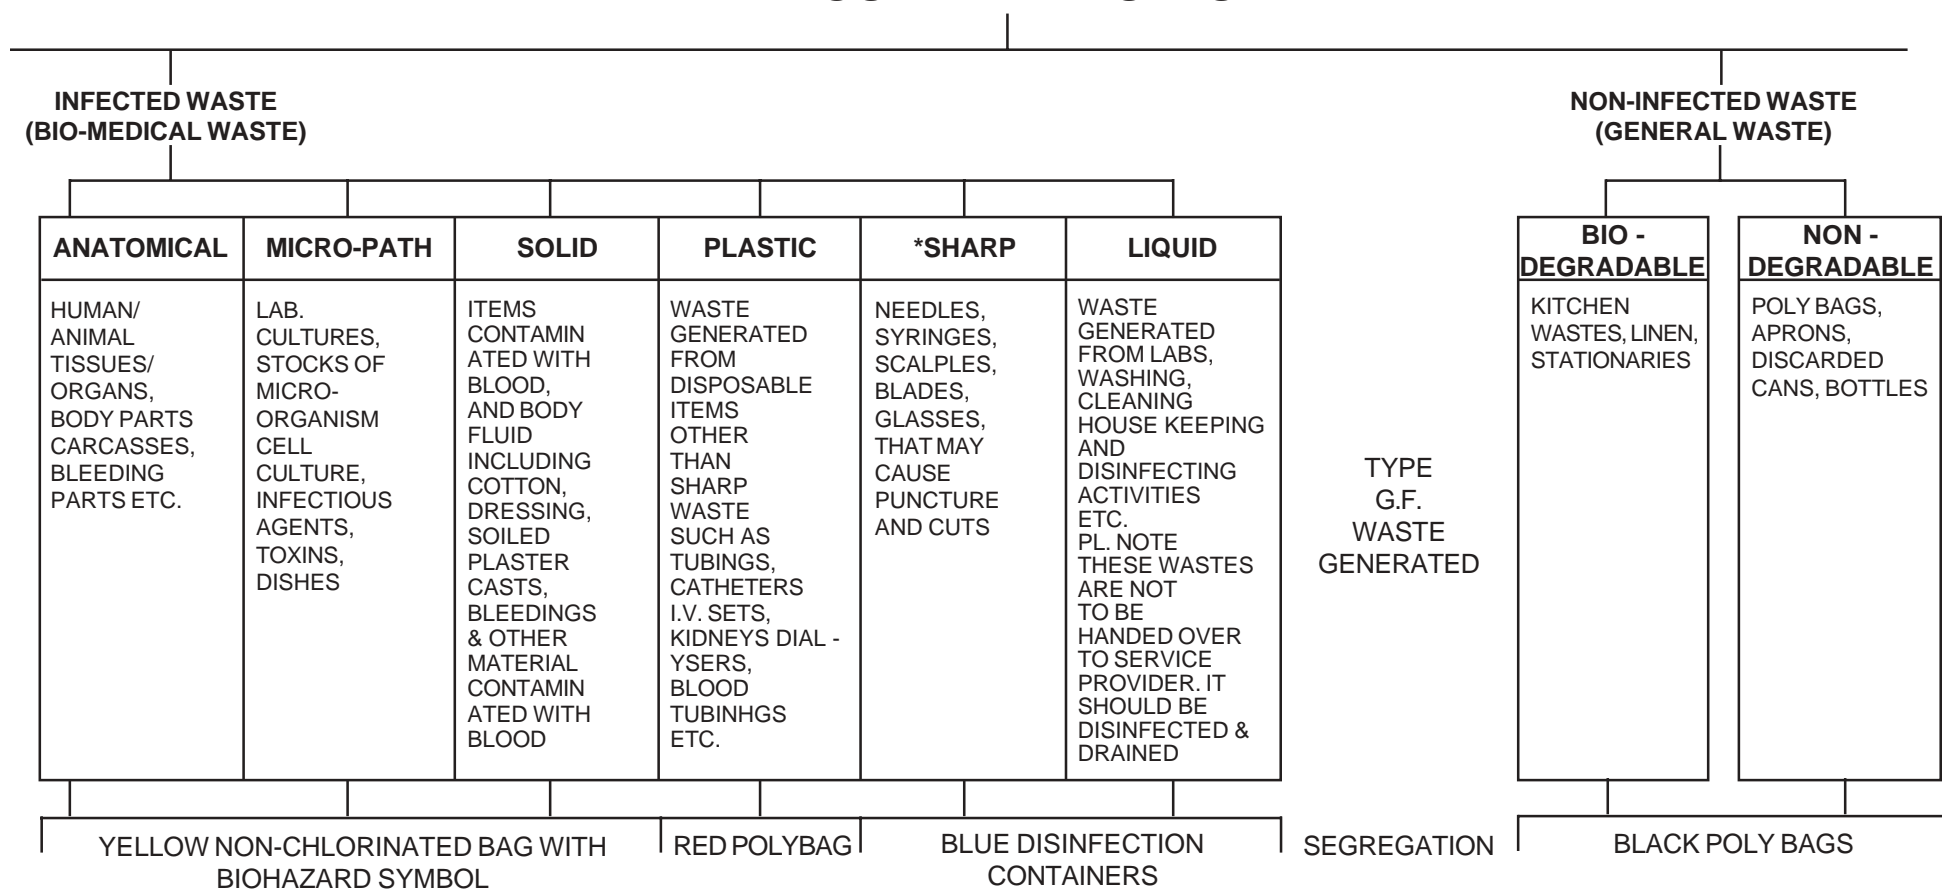

- NOTE :**
1. General municipal waste (As discribed above) are NOT handled by us and are NOT to be packed in our Bags whether Yellow or Red. It should be packed in BLACK bags, which can be supplied by us if required, and to be placed in the MUNICIPAL DUMP.
 2. All Ampulated limbs will need to carry a certificate that this part has been amputated in this Healthcare unit and will not be collected otherwise.
 3. The Waste generator is required to have a blue/whilte puncture proof container for sharps such as needles, scalpels, blades, glasses, etc. from where it will be transferred into the Puncture proof container kept in the service provider's vehicle deputed for collection.

di ; k l eLr FkS@dpjk dk; ZÜkkZ/ka dks bl vk"; l s inkü djafd iR; d FkS ij f"kfMY; WM&4 ¼kkjk 6½ ck; kesMdy vf/kfu; e 1998 ds vuq i gkA
WpfdRI ky; & dpjk i zksB½

**I Øked & dpjk
 ½ck; ks fpfdRI k dpjk½**

vi Økfed I k/kj.k & dpjk

i hysjak dh FkSy; ka ea
1- ekuo i "kq/ka ds rariq "kkj hfjd jDr&jãtr vak@Hkkx vkfnA
2- iz kx"kkYkVka ea fudyk gYk v. kj tho dks"kdka, a, oa tbfed dpjs dh FkSy; kj
3- Bkd jDr ds nfr'kr no iz k/ku] Bkd vkskf/k ys dk l kpk , oaxnh i fVV; kj : bz bR; kfnA
4- iz kx"kkYk l sfudyh gpbZ ij [kufy; kj ½dkey yphyh <yus ; kx; inkFkZ vkfn½

yky jak dh FkSy; ka ea
1- l eLr VW/k&QW/k@ iz kx fd; k gYk VW/k dSfK/I j vkbZch] xpñ l Ecd/kr jDr&jãtr fV; ficak ds vfrfjDr gkA
2- dkbZ Hkh yphys o <yus ; kx; inkFkZ jDr jãtr&dpjk] ckrya vkfnA

uhysjak dh FkSy; ka ea
1- iz kx gpbZ l bZ kj Nnu; ; ã ds VpIM½½yM½ vkfn½A
2- VW/s gq dkp ds VpIM@ckrya vkfnA
3- dkjp dh ufy; kj bR; kfnA

dkys jak dh FkSyh ea	
ck; k&ekud ea of. kr	udkj kRed ekud ea of. kr
1- j l kbZ ?kj ea iz Ør dpjk tS s xRrs ds fMcc] dkxt] fyQkQs vkfnA	1- yphys <yus ; kx; FkSy; kj xUns di Mls ds VpIM½ VW@ iz kx gq xRrs ds fMccs ½dkVMI ½ bR; kfnA

fVli .lh %

- 1- l k/kj.k uxj ikfydk dpjk ½mi jkDrkuq kj½ gekjs }kjk i hys vFkok yky FkSy; ka ea ughafy; k tk; skA
- 2- l eLr dVs gpbZ i kf.k; ka ds vak B, d i æf.kd i æk.k&i =p ds l kFk Hkstuk vko"; d gSftl ea Li'V nfr'kr gksfd mDr ¼ Ecd/kr½ vak b l LokLF; dñz }kjk Hstak tk jgk gS vU; Fk , df=r ughafd; k tk; skA
- 3- l eLr mRI fxd dpjk vko"; d gSfd uhys@l On Nnu; ã ds VpIM½ dUVsjka ea , d= djds fy; k tk; sk ftl l smlga Nnu; ã dUVsjka ea LFkkukUrfjr djds l g f{kr xkM½ ea bdVBk djds jD[kk tk l dA